



District Level Water Analysis Laboratory UP Jal Nigam (Rural), Bulandshahr

TEST REPORT

Report No :	: 0173	Issue Date	29/07/2026
Sample receipt Date:	: 28/07/2026		
Customer/Party Name	: AZAD PUBLIC SCHOOL		
Address	: AZAD NAGAR, BULANDSHAHR - 203001		
Contact No.	: 9927099333		
Date of Sampling	: 28/07/2026	Sample Code: B 256	
Sample Description	: 28/07/2026	Quantity of Sample	1000ML
Quantity	: 1	Water Source	Normal Water
Packing details	:	Sampling Method	As per IS 17614:Part-2021
Analysis Start	: 28/07/2026	Analysis Completion Date	29/07/2026
Temperature	: 26.8°C	Humidity	56%
Water Sample CollectorAdarsh Kumar			
Availability of Equipments:		Availability of reference standards:	Adequacy of sample quantity 01
Availability of Test method:	IS 3025	Availability of Trained person:	Duration of testing/Time of Report release 12:55 pm

TEST PARAMETER

S. N.	Test Parameters	Method	Specification		Result	(Unit)
1	pH	IS 3025 (Part 11): 2022	6.5-8.5	No Relaxation	7.325	-
2	Turbidity	IS 3025 (Part 10): 2023	1.0	5.00	1.548	(NTU)*
3	TDS	IS 3025 (Part 16): 2023	500	2000	435.9	(Mg/L)*
4	Chloride	IS 3025 (Part 32): 2019	250	1000	200	(Mg/L)*
5	Total Alkalinity	IS 3025 (Part 23): 2023	200	600	402	(Mg/L)*
6	Total Hardness	IS 3025 (Part 21): 2019	200	600	386	(Mg/L)*
7	Colour (Hazen)	IS 3025 (Part 4): 2021	5	15	9	Hazen
8	Taste	IS 3025 (Part 8): 2023	Agreeable	Qualitative	Agreeable	Qualitative
9	Odour	IS 3025 (Part 5): 2022	Agreeable	Agreeable	Agreeable	Agreeable
10	Calcium as Ca	IS 3025 (Part 40): 2023	5	200	120	(Mg/L)

11	Magnesium as	IS 3025 (Part 46): 2023	30	100	50.22	(Mg/L)
12	Sulphate as SO ₄	APHA 24 th Edition -4500-SO ₄ Method E (Turbidimetric Method) 2023	26	200	63	(Mg/L)
13	Nitrate as NO ₃	APHA 24 th Edition -4500-NO ₃ Method D (UV Screening Method) 2023	12	45	19	(Mg/L)
14	Fluoride as F ⁻	APHA 24 th Edition – 4500 – F Method C (Electrode Method) 2017-2023	0	1	0.16	(Mg/L)
15	Electrical Conductivity EC		0.5	3	421.5	µs/cm
16	Iron	IS 3025 (Part 53):2003	0	1	0.25	(Mg/L)
Remark		"The Information regarding sample collected, submitted and Customer basic details provided by the customer itself."				

-:REVIEW ON ANALYSIS:-

Only basis of above parameter analysis data values for given sample within safe range and under Acceptable Limit according to BIS 10500:2012.

- PASS (✓)
- FAIL ()


Reviewed By

End of Report

Page 2 of 2



Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 2026/115

Dated: 29-7-2026

It is certified that an inspection team headed by Emergency Medical Officer

(Name of Officers with designation) from DR. Anuj Kumar PHED

inspected the AZAD PUBLIC SCHOOL, BULANDSHAHR

(Name & Address of the school) on 29-7-2026 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. 0173 dated 29-7-2026

of District Level Water Analysis Laboratory (PHED Lab) certified that
U.P. Jal Nigam (Rural), Bulandshahr

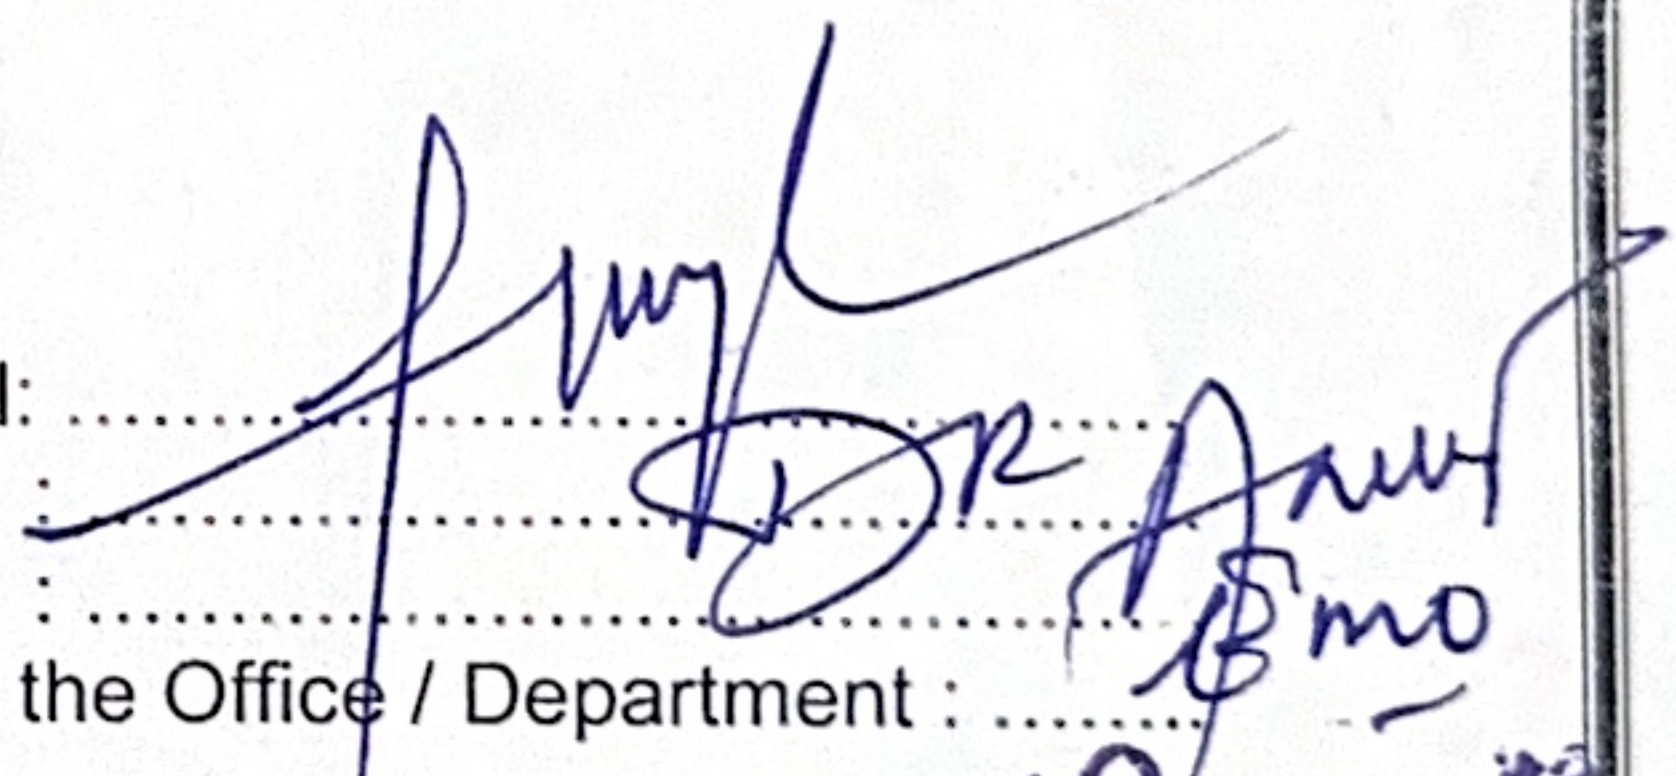
the AZAD PUBLIC SCHOOL (Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 28-07-2027

Signature with Seal: 

Name

Designation

Name & Address of the Office / Department :

To

AZAD PUBLIC SCHOOL
AZAD NAGAR, BULANDSHAHR
(Name & Address of the Institution)

E.M.O.
(SGMC & BBD Hospital)
Bulandshahr

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies